



SECTION 3.1_KSFI

FLAME ARRESTER DEFLAGRATION PROOF IN-LINE

INTRODUCTION

 **The model KSFI** inline flame arrester is designed, manufactured, tested according to API 2000, and ISO 16852. The units are passive devices with no moving parts. They prevent the propagation of flame from the exposed side of the unit to the protected side by the use of a 316L stainless steel crimped metal ribbon type flame cell element. This construction produces a matrix of uniform opening that are carefully constructed to quench the flame by absorbing the heat.

Operating Temperature @ Pressure

KSFI / DN 15 ~ DN 600	+ 60 °C (=140°F) @ 0.11 Mpa
-----------------------	-----------------------------

 **Body Materials** Aluminium, Nodular Iron, Cast Steel, SS304, SS316, SS316L with various trims
(Different materials available on request)

 **Sizes range** DN 15 ~ DN 600 with ASME 150Lb flanges
(Different connections available on request)


 **Rules & Certifications** API 2000 / ISO 16852 & KFI
Flame cell : NEC group D (=IIA), group C(=IIB3) and group B(=IIC), ETC.

 **Optimum / optional Design & Arrangements** Steam Jacket type

APPLICATION



OUTLINE DRAWING

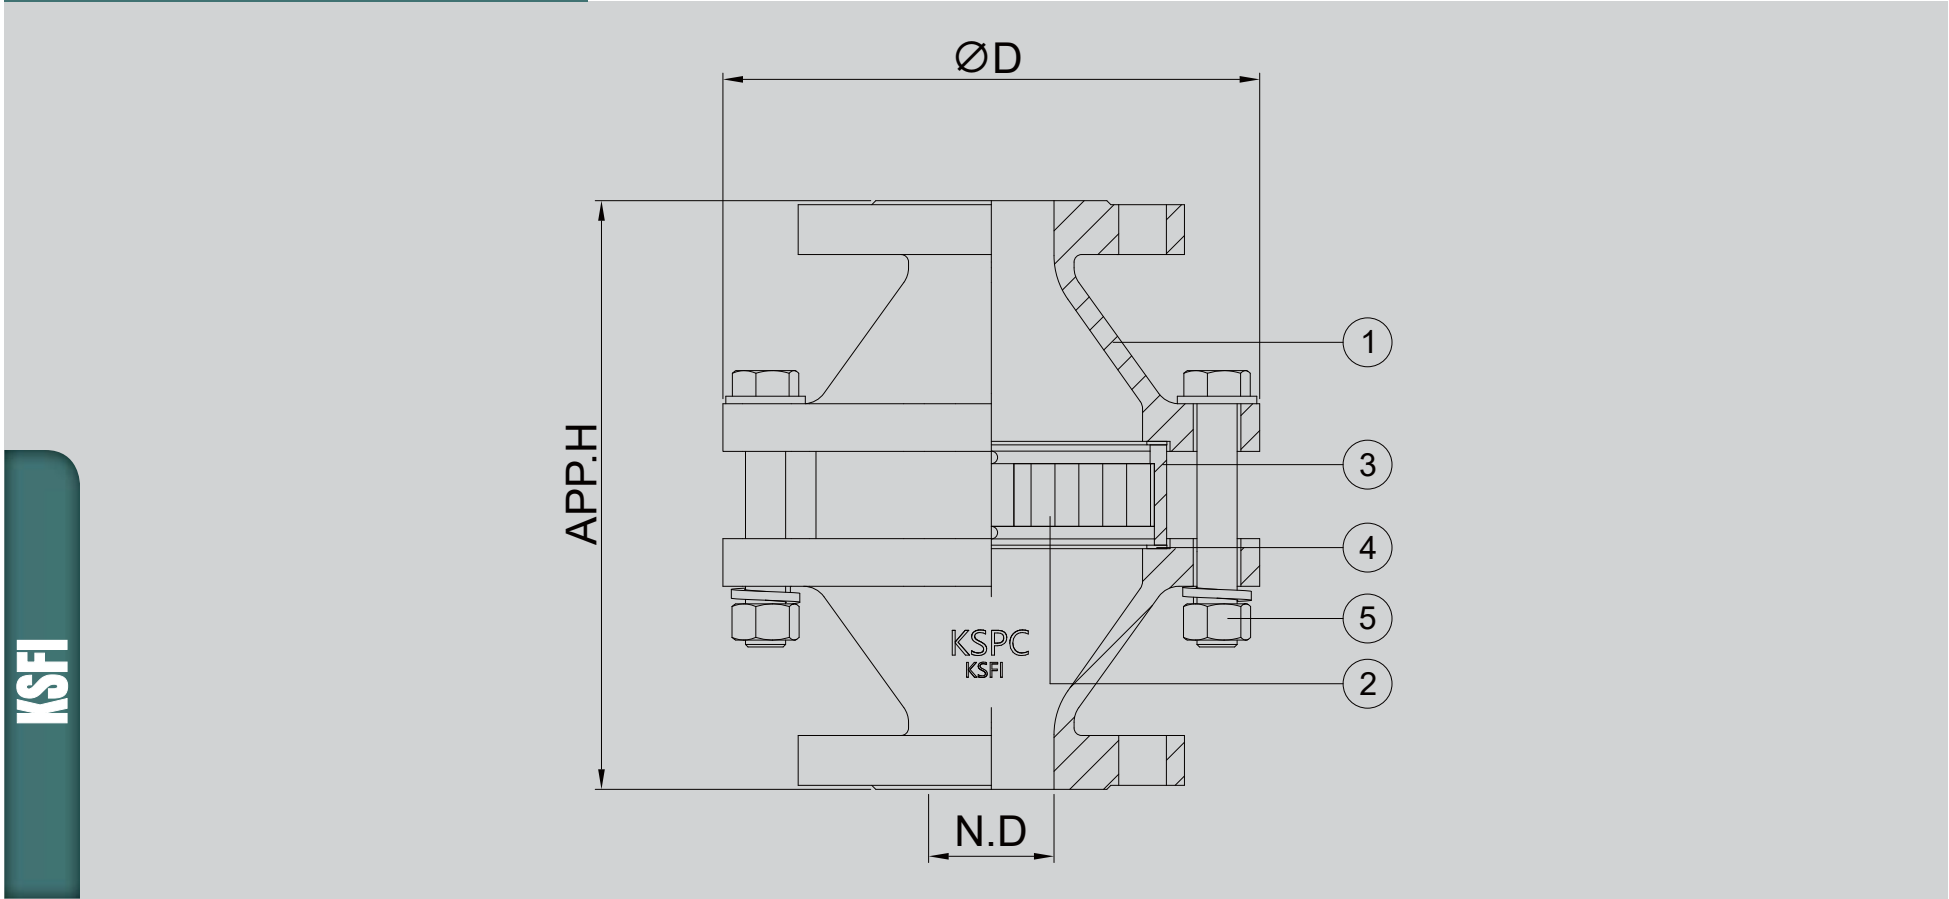

DIMENSION TABLE

NOTE Standard Connection(ASME 150Lb flange) and JIS or different types are available upon request.

SIZE	½"	¾"	1"	1 ½"	2"	3"	4"	6"	8"	10"	12"	14"	16"	18"	20"	24"
N.D	15	20	25	40	50	80	100	150	200	250	300	350	400	450	500	600
ØD	155	155	155	214	225	251	300	389	450	600	680	745	850	930	1000	1240
App.H	221	226	229	231	234	253	262	326	342	376	454	486	511	529	541	732

COMPONENT MATERIAL

NOTE Other materials are available upon request.

ITEM NO	COMPONENT	ALUMINIUM	CARBON STEEL	STAINLESS STEEL
1	BODY	CAST ALUMINIUM	CAST or WELDED C.S	CAST or WELDED S.S
2	ELEMENT	SS316L		
3	ELEMENT HOUSING	SS304L	SS304L	SS304L/SS316L
4	GASKET	PTFE (NOTE)		
5	STUD BOLT/NUT	A193-B7 / A194-2H or STAINLESS STEEL		
STANDARD PAINTING		IN-OUT SIDE URETHANE 150 MICRON WITHOUT S.S & AL PART		

MAINTENANCE

- Periodic inspection and maintenance is required. The cell assembly can be removed for cleaning purposes.
- Cleaning can be accomplished by dipping the entire cell assembly into an appropriate solvent.
- Care should be taken not to damage the cell openings as such deformations hamper the flow through the cell.
- The gaskets should be inspected and replaced if necessary.